



UL Online Certifications Directory

[Home](#) [Quick Guide](#) [Contact Us](#) [UL.com](#)

BXUV.Y737 **Fire Resistance Ratings - ANSI/UL 263**


[Page Bottom](#)

Fire Resistance Ratings - ANSI/UL 263

[See General Information for Fire Resistance Ratings - ANSI/UL 263](#)

Design No. Y737
May 02, 2012

Rating — 2 Hr.

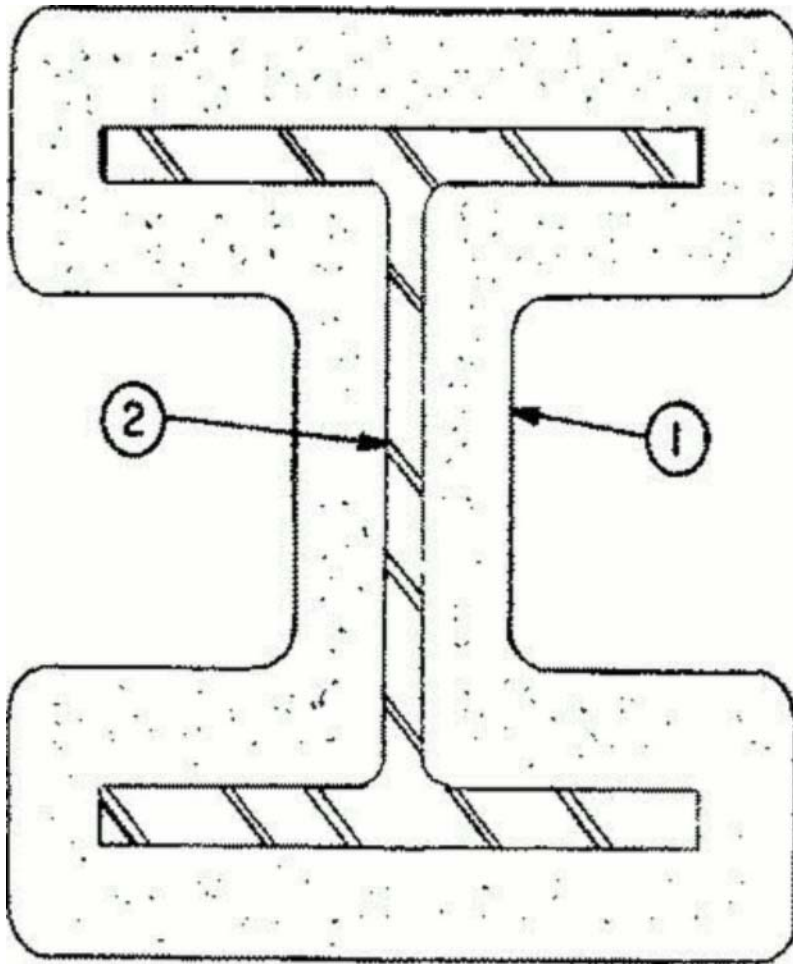

1. **Spray-Applied Fire Resistive Materials*** — See table below for appropriate thickness. Applied in several coats to steel surfaces which must be clean and free of dirt, loose scale and oil. Min avg density of 35 pcf with min ind density of 32 pcf. For method of density determination, refer to Design Information Section, Sprayed Material.

Rating Hr	Min Thkns In.
2	1-3/16

VELLRATH ENGINEERING — Type UNIVERSAL FIREPROOFING PATCH.

2. **Steel Column** — W10X49, min size.

*Bearing the UL Classification Mark

[Last Updated](#) on 2012-05-02

© 2012 UL LLC

When the UL Leaf Mark is on the product, or when the word "Environment" is included in the UL Mark, please search the [UL Environment database](#) for additional information regarding this product's certification.

The appearance of a company's name or product in this database does not in itself assure that products so identified have been manufactured under UL's Follow-Up Service. Only those products bearing the UL Mark should be considered to be Listed and covered under UL's Follow-Up Service. Always look for the Mark on the product.

UL permits the reproduction of the material contained in the Online Certification Directory subject to the following conditions: 1. The Guide Information, Designs and/or Listings (files) must be presented in their entirety and in a non-misleading manner, without any manipulation of the data (or drawings). 2. The statement "Reprinted from the Online Certifications Directory with permission from UL" must appear adjacent to the extracted material. In addition, the reprinted material must include a copyright notice in the following format: "© 2012 UL LLC".